


Note:  
Conduit, drain tubes and cap  
may be galvanized steel or PVC.

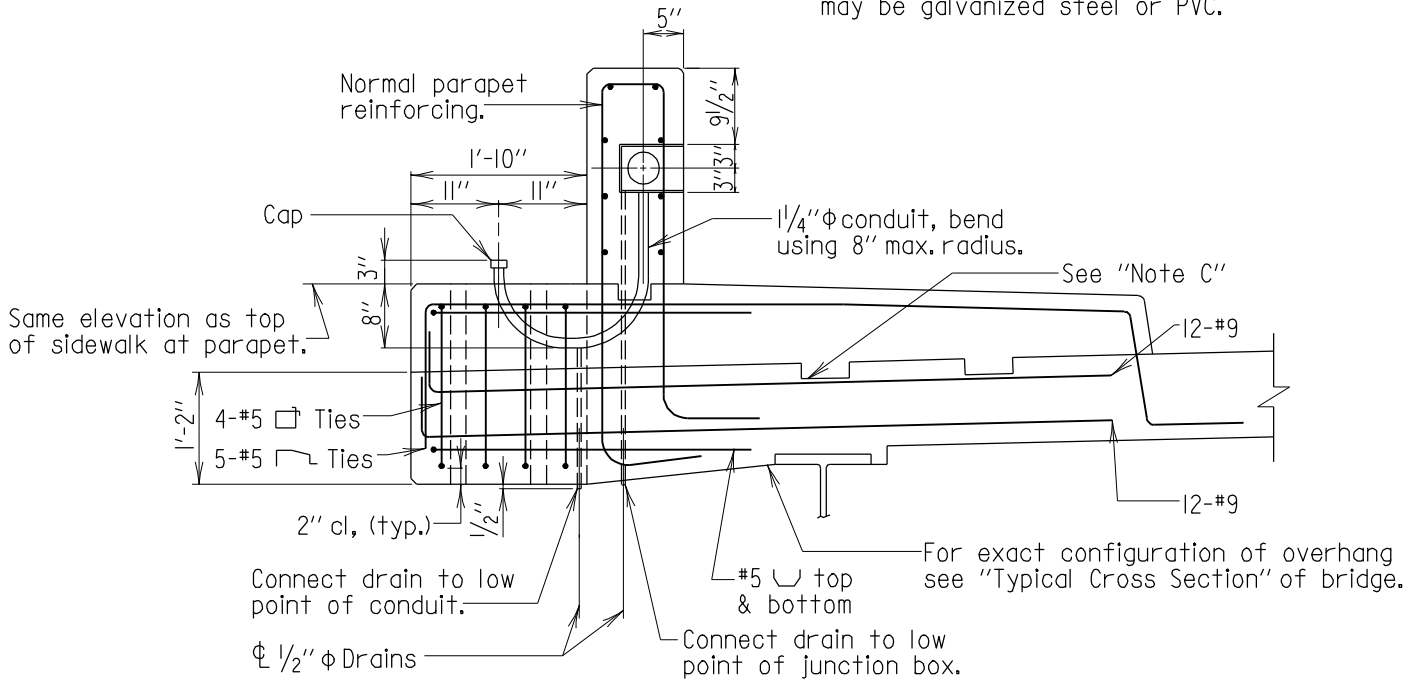

### SECTION B-B FOR SIDEWALKS WITH PARAPET

Scale: 1/2"=1'-0"

Note:

All longitudinal bars are #5's and shall be placed continuously in the sidewalk from expansion opening to expansion opening in a simple span bridge and expansion opening to centerline of pier in a multispan bridge. Refer to BR-SS(6.21)-03-106.

Note C:

The constr. jt. between the sidewalk and the deck may vary slightly from the joint indicated.

For exact details and location of the joint see "Superstructure" Sheet.

## SIDEWALK STRAIGHT BACK

APPROVAL	
<i>L. S. Friedman</i> DIRECTOR	OFFICE OF STRUCTURES
DATE: 6/11/05	
REVISIONS	
SHA	FHWA
10-9-07	.
.	.
.	.
FHWA APPROVAL	.
DATE:	.

STATE OF MARYLAND  
DEPARTMENT OF TRANSPORTATION  
STATE HIGHWAY ADMINISTRATION  
OFFICE OF STRUCTURES



SUPPORT BRACKET FOR BRIDGE MOUNTED LIGHT POST  
WITH SINGLE CONDUIT AND PARAPET  
WITH STRAIGHT BACK AND SIDEWALK

STANDARD NO. BR-SS(6.51)-05-353(L)

SHEET 2 OF 2

SUPER-CONCRETE WORK